
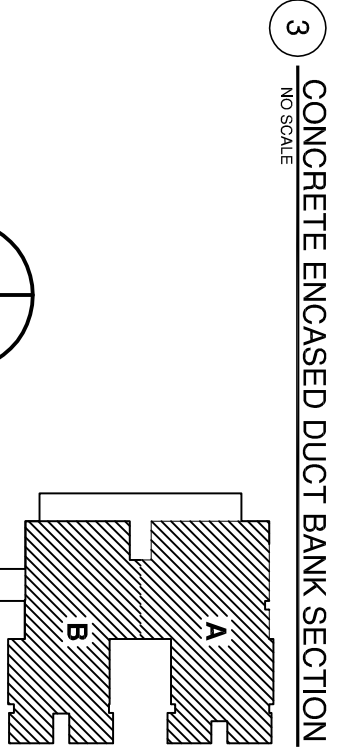
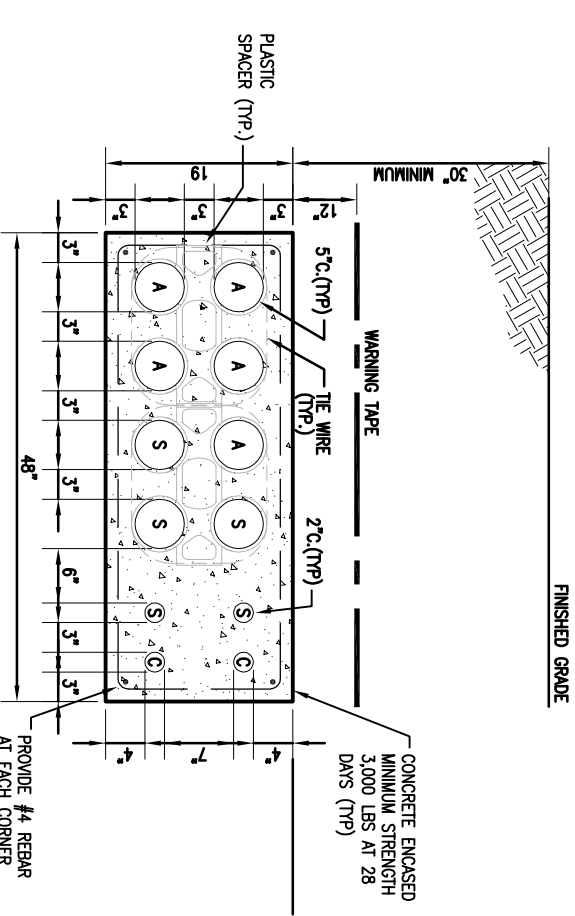


- KEYED NOTES:
1. DUCT ALTERNATE #1
 2. DUCT ALTERNATE #2
 3. DUCT ALTERNATE #3
 4. PRIMARY FEEDER, DUCTBANK, AND PAD MOUNTED TRANSFORMER BY DOMINION POWER. FINAL LOCATION TO BE BY DOMINION POWER. SEE DETAIL 2 THIS SHEET FOR SECONDARY DUCTBANK BY CONTRACTOR.
 5. PAD/MAL CIRCUIT. SEE E30-202.
 6. NOT USED.
 7. FOUNTAIN PUMP CONNECTION.
 8. EMERGENCY GENERATOR FUEL TANK. SEE CIVIL FOR FINAL LOCATION.
 9. TELECOM/SECURITY/MECHANICAL/FIRE ALARM DUCT BANK CONNECTING TO ROUTER BUILDING #501. CONTRACTORS TO VERIFY EXACT LOCATION AND ROUTING WITH OWNER. SEE DETAIL 3 THIS SHEET FOR DUCTBANK DETAIL.
 10. SEE DETAIL 2 THIS SHEET FOR EMERGENCY GENERATOR DUCTBANK.
 11. EMERGENCY GENERATOR

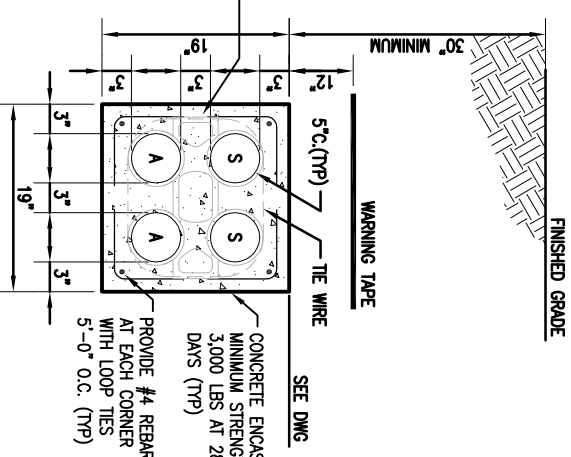

FULLY SPRINKLERED

Amendment 1	09/11/08	CONSULTANTS:		ARCHITECT/ENGINEERS:	HDR HDR Architecture, Inc 1101 King Street Suite 400 Alexandria, Virginia 22314-2941 703.518.8500 5426 Bay Center Drive Suite 400 Tampa, Florida 33609-3444 813.282.2483
Amendment 2	09/18/08				
Revisions:					
	Date				
		Drawing Title	Project Name	Project Number	Office of Facilities Management 
		ELECTRICAL SITE PLAN	HUNTER HOLMES MCGUIRE	V101BP 0241	
		Approved: Project Director	Location	Drawing Number	
			Date 07/24/2008	Checked	Building Number
				Drawn	
				Dwg. of	ESO-201